


Loudoun Water



County Population

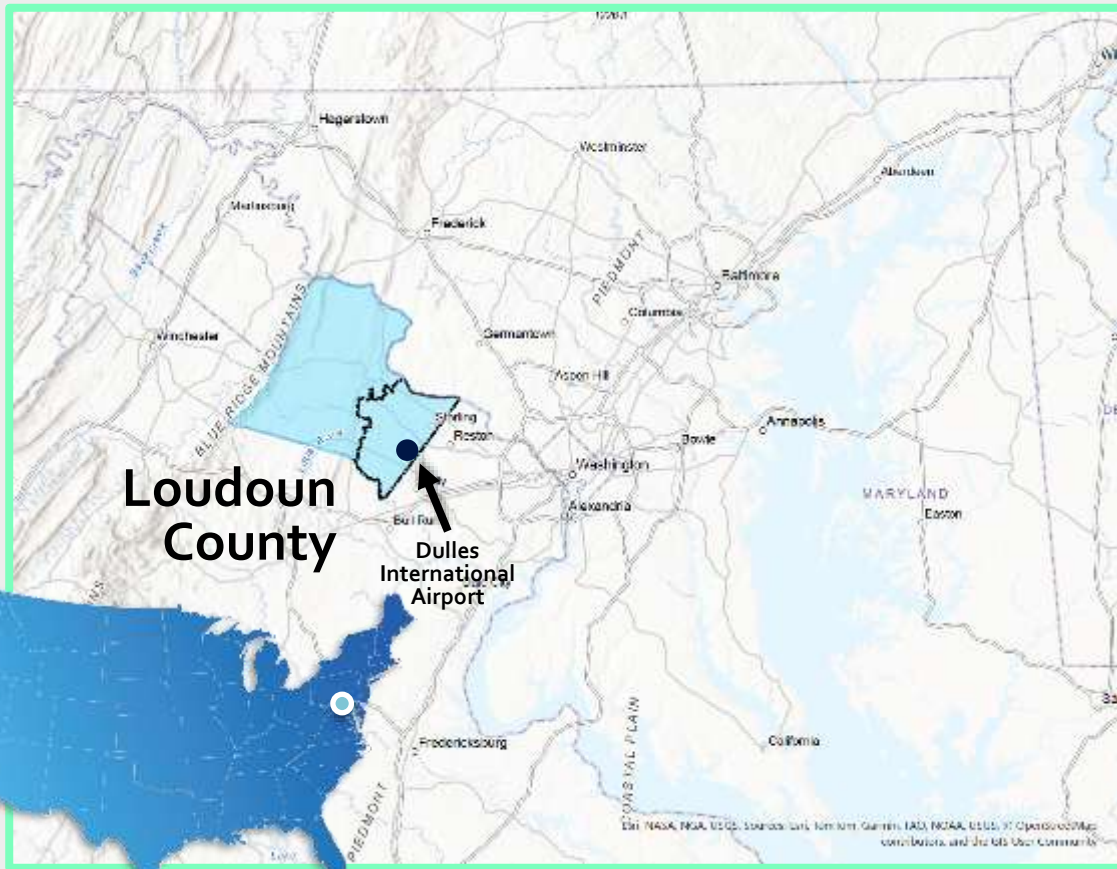

455,000

Loudoun Water Customers



350,000
population



88,000
accounts



29 MGD (Avg)
49 MGD (Max)



2.2 MGD (Avg)
5.5 MGD (Max)



29 MGD (Avg)


Types of Data Centers

LOUDOUN WATER



206
Total data centers
In Loudoun Water's
Service Area

Loudoun Water Central Service Area (2025)

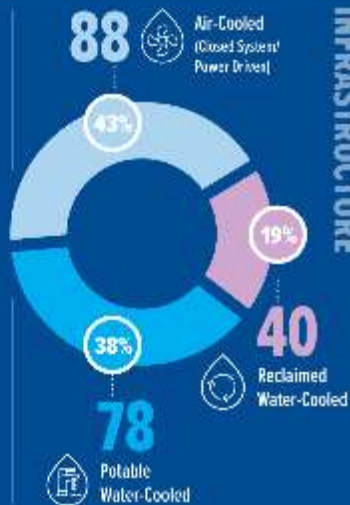

Loudoun Water Central Service Area As of (2025)

LOUDOUN WATER

WATER USE

Million gallons per day (mgd) average

**AVERAGE
DAY**



**MAXIMUM
DAY**



349,000
PEOPLE SERVED



88,000
All Loudoun Water
Connections


Total Potable Water Supply Usage: Average Day

LOUDOUN WATER

90 mgd
Permitted Water
Capacity for Future

29.0 mgd
Daily Water Use:
All Loudoun
Water Customers

2.6 mgd
Daily Water Use:
Data Centers Only

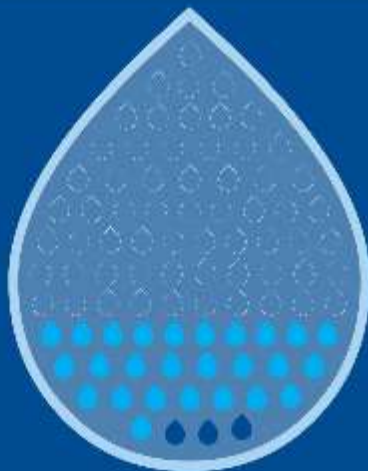

Loudoun Water Center Service Area (2025)

Total Potable Water Supply Usage: Maximum Day

LOUDOUN WATER

90 mgd
Permitted Water
Capacity for Future

50.0 mgd
Daily Water Use:
All Loudoun
Water Customers

8.0 mgd
Daily Water Use:
Data Centers Only



Loudoun Water Center Service Area (2025)

